


NOTE: IF PATCH EXCEEDS 30' IN LENGTH
EXPANSION JOINTS TO MATCH EXISTING OR
AT 30' INTERVALS, WHICHEVER IS LESS (JOINT SEALER-N.C.D.O.T. NO. 920.2

BROKEN BROKEN EDGES WILL BE
SAWED WITH A CONCRETE SAW TO
A NEAT LINE AND BROOMED CLEAN
BEFORE PLACING PATCH. PATCH
WILL MATCH EXISTING PAVEMENT
(NOTE: SAW TO A DEPTH OF 2.5"
TO ENSURE THAT UNDER-BREAKAGE
DOES NOT OCCUR.

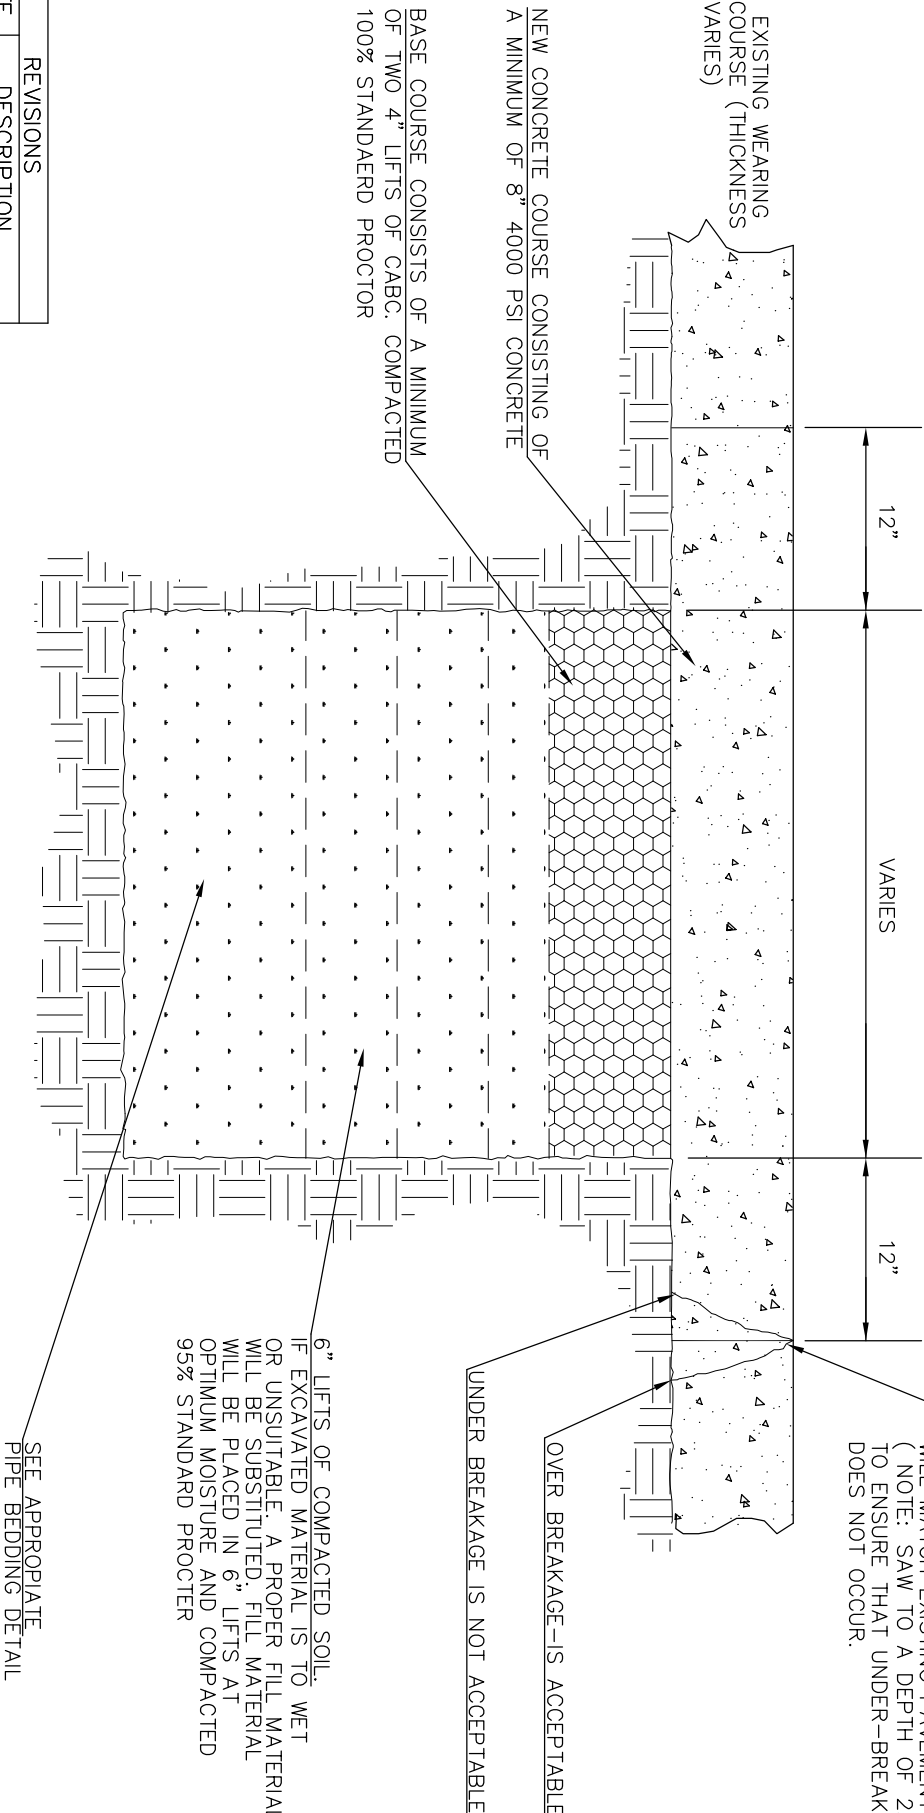

SEE APPROPRIATE
PIPE BEDDING DETAIL

6" LIFTS OF COMPACTED SOIL.
IF EXCAVATED MATERIAL IS TO WET
OR UNSUITABLE. A PROPER FILL MATERIAL
WILL BE SUBSTITUTED. FILL MATERIAL
WILL BE PLACED IN 6" LIFTS AT
OPTIMUM MOISTURE AND COMPACTED
95% STANDARD PROCTOR

UNDER BREAKAGE IS NOT ACCEPTABLE

OVER BREAKAGE - IS ACCEPTABLE

REVISIONS

DATE DESCRIPTION

CITY OF ASHEVILLE, N.C.
ENGINEERING DEPARTMENT

RIGID PAVEMENT REPAIR

STD. No.

5.02

